

Grażyna SAKSON¹
Agnieszka BRZEZIŃSKA²
Krzysztof KOWALSKI³

MONITORING, EARLY WARNING AND SUSTAINABLE MANAGEMENT SYSTEM FOR LODZ WASTEWATER TREATMENT PLANT AS A WATER PROTECTION TOOL

Abstract: Municipal wastewater treatment plants are exposed to the inflow of toxic substances, which may hamper or even preclude their proper functioning, especially of the biological part. In the case of combined or hybrid sewer systems, additionally, in wet weather, there may appear a rapid inflow of a mixture of domestic and industrial sewage, and stormwater in an amount exceeding the capacity of the devices, causing the need to discharge parts of not fully treated wastewater through the bypass channel, which may reduce overall treatment effects. In such situations, the receivers are exposed to an inflow of increased amounts of pollutants, which on the one hand causes a threat to the aquatic environment, on the other, may result in administrative fines for the treatment plant resulting from non-compliance with the conditions of the water permit, as well as costs of removing the effects of failure. The article presents the concept of a monitoring, early warning and sustainable management system for the Lodz wastewater treatment plant, which will allow minimizing pollutant emissions to the aquatic environment. The system will be based on data from the municipal pluviometer network, measurement of flows in combined sewer overflows and newly built sewage quality monitoring stations equipped with on-line probes. The resulting data will allow to predict quantity and quality of inflow to the treatment plant, which will allow for an early warning about the dangers. In consequence decision-making to improve the safety of its operation will be possible.

Keywords: sewer system, sewage treatment, water protection, predictive model, toxicity

¹ Corresponding author: Grażyna Sakson; Lodz University of Technology Institute of Environmental Engineering and Building Installations, Al. Politechniki 6, 90-924 Łódź; grazyna.sakson-sysiak@p.lodz.pl. <http://orcid.org/0000-0002-6022-7771>

² Agnieszka Brzezińska; as above; agnieszka.brzezinska@p.lodz.pl; <http://orcid.org/0000-0001-5913-8029>

³ Krzysztof Kowalski; Wastewater Treatment Plant of Lodz, Ltd. Sanitariuszek 66, 93-469 Łódź; krzysztof_kowalski@gos.lodz.pl

1. Introduction

Municipal wastewater treatment plants (WWTP), due to the increasing requirements of environmental protection, have to meet more and more stringent requirements regarding both the quality of discharged sewage and operational reliability. This is sometimes difficult due to unforeseen situations, usually independent of the sewer network operator and sewage treatment plant. Municipal WWTPs are exposed not only to technical equipment failures, but also to an uncontrolled inflow of toxic substances that can inhibit biological treatment processes and, in extreme cases, lead to their breakdown. Such situations may be caused by intentional action (illegal discharge of wastewater into the sewage system), but also may be the effect of introduction of new substances and products, which in turn results in the introduction of new contaminants to a treatment plant, whose effects on living organisms is not fully recognized. In the case of combined sewage system, hydraulic overload resulting from stormwater inflow after prolonged and intense rainfall, is an additional threat, which may also worsen the effects of treatment. In both cases, not fully treated wastewater may be discharged to the receiver. Such situation causes a threat to the aquatic environment on the one hand, and on the other may result in financial penalties for treatment plants, resulting from non-compliance with the conditions for sewage disposal, as well as costs of removing the effects of failure (e.g. restoration population of microorganisms in activated sludge chambers).

According to the current legal status in Poland, the requirements for the quality of sewage discharged to the receiver increase with the size of the treatment plant, but they do not take into account the size and absorbency of the receiver, which is crucial for the possibility of maintaining its good condition or good ecological and chemical potential. The impact of discharged wastewater on the receiver depends primarily on the pollutant load and the dynamics of emissions, and of course depends on the size of the receiver. Rapid changes in the level of pollutant emissions are dangerous especially for small receivers, which is why sewage treatment plants discharging sewage to them should be particularly well protected against the possibility of discharge of not fully treated sewage.

Significant sudden changes in the quality of inflow to WWTP, and primarily the presence of toxic substances, can affect the reduction of the biological treatment efficiency. In particular, nitrifying bacteria are sensitive to the effects of toxic factors such as increased heavy metal concentration, pH changes, reduced oxygen concentration and rapid changes in ammonium nitrogen concentration in the inflowing sewage [1]. Wastewater toxicity is more and more often the subject of research, however, generally used methods do not allow its simple and reliable on-line measurement. Attempts to establish a correlation between sewage toxicity and physicochemical parameters are not effective yet. Vasquez and Fatta-Kassinos [2] have only established that two parameters: conductivity and ammonium nitrogen concentration are related to toxicity. Research conducted by Liwarska-

Bizukojć et al. [3] in the wastewater treatment plant in Zgierz did not show any significant correlation between toxicity and basic parameters of wastewater (pH, BZT₅, COD, ammonium nitrogen, total nitrogen, total phosphorus), and their biodegradability BZT₅/COD). Only a weak correlation was found between the conductivity and toxicity of raw wastewater in the short-time summer campaign.

Rapid changes of inflow may cause difficulties in optimal control of municipal sewage treatment plants cooperating with the combined sewer system which is largely due to the unpredictability of precipitation. For this reason, attempts to forecast inflow to the treatment plant with sufficient time in advance are being made in the world. Based on rainfall data (currently occurring or forecast from radar data) and measurements of sewage depth and flow in the sewers, RTC (Real Time Control) systems are being created [4, 5]. Solutions for forecasting the WWTP inflow using artificial intelligence methods, such as neural networks, neural-fuzzy networks, etc. are also being developed [6-8]. Attempts to include into these systems tools that enable qualitative forecasting of inflows are being made [9]. According to Vezaro et al. [8] controlling the sewage system based on the measurement of WWTP inflow quality allows to mitigate the effects of first wave of pollutants phenomenon.

However, there are currently no solutions enabling comprehensive forecasting of both the sewage inflow to the treatment plant and the concentration and loads of pollutants. Meanwhile, early warning of treatment plants about the possibility of hazards could enable, for example, storage of some wastewater not only to avoid hydraulic overloads, but also inflow of toxic substances or excessive loads of pollution to the biological part. This would create a chance for optimal control of treatment processes in all conditions and, as a consequence, better protection of the sewage receiver. Such a system is currently being developed in Lodz as part of the project "Development of a monitoring, early warning and sustainable management system for wastewater treatment plants minimizing emissions to the aquatic environment from the urbanized area" implemented by the scientific and industrial consortium: Lodz University of Technology and Wastewater Treatment Plant of Lodz, Ltd.

2. Characteristics of Lodz sewer system and WWTP

Lodz is equipped with a hybrid sewage system. In the central part there is a combined sewer system with 4 main collectors running from the north-east to the south-west of the city towards the Group Wastewater Treatment Plant of the Lodz Agglomeration (GOŚ ŁAM). Two sanitary sewers collecting sewage from northern and south-eastern regions of Lodz are included in this system. Two sewage collectors from Pabianice and Konstantynów Łódzki are connected to the system prior to WWTP. There are 18 combined sewer overflows in the combined sewerage in Lodz, equipped with a flow measurement system.

Currently, wastewater from the cities of Łódź, Pabianice, Konstancynów Łódzki and the municipalities of Nowosolna and Ksawerów flows into GOŚ ŁAM. These areas are inhabited by nearly 800 thousand people. The designed capacity of the treatment plant is 1.026.260 PE, while the actual load on the treatment plant, calculated on the basis of operational data from 2015-2017, is currently 934.700 PE. Maximum sewage inflow to the treatment plant during wet weather for a probability of 85% is 166,000 m³ per day.

Wastewater flowing into the wastewater treatment plant is first subjected to mechanical treatment in the screens building, than wastewater flows into the grit chamber. The final facilities of mechanical wastewater treatment are rectangular preliminary settling tanks. Biological sewage treatment is carried out in activated sludge chambers operating in MUCT technology. The following zones are separated in each technological line:

- anaerobic compartment,
- anoxic compartment,
- aerobic compartment.

The final treatment facilities are rectangular secondary settling tanks blocked with activated sludge chambers. The separated sludge is discharged to four recirculation pumping stations, where its main stream is directed back to the activated sludge chambers, and some removed as excess sludge for further processing in the sludge treatment plant part. The treatment plant scheme is presented in Fig. 1.

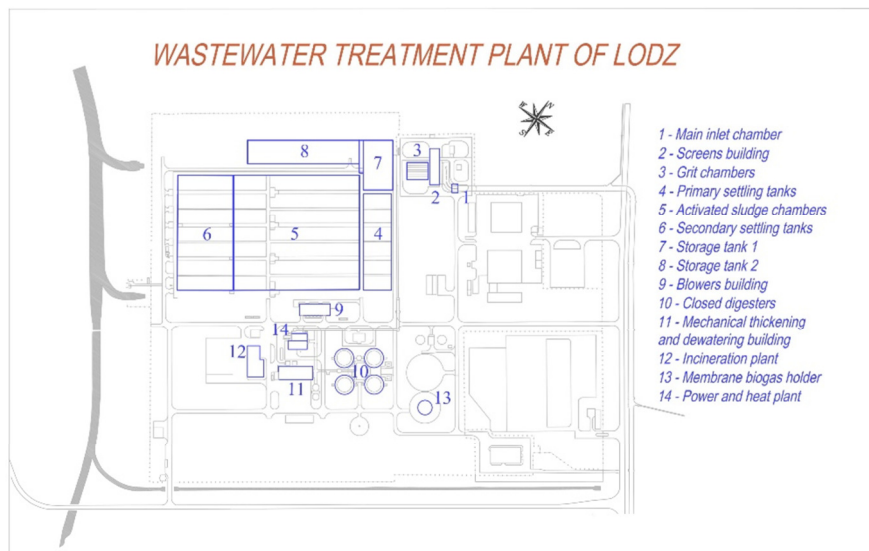


Fig. 1. Schematic of the Group Wastewater Treatment Plant of the Lodz Municipal Agglomeration

In dry weather, the sewage inflow to the treatment plant, in terms of both quantity and quality, is stable. Under these conditions, the characteristics of the inflow during the day or week are repeatable, and its changes are relatively small. It is different during wet weather, when the amount of inflowing sewage increases significantly, sometimes rapidly, and can cause WWTP overload, especially the biological part. Therefore, there are situations in which not all wastewater flowing into the GOŚ ŁAM is fully treated. Part of the wastewater after the primary settling tanks, and in extreme cases after the grit chambers, is directed to the bypass channel, which may contribute to increased emission of pollutants to the receiver compared to other periods.

Although in recent years the annual rainfall in the city and the number of wet weather days do not show an upward trend, the occurring rainfall is characterized by a higher maximum intensity, which may cause a rapid increase in the sewage inflow to the treatment plant (Fig. 2).

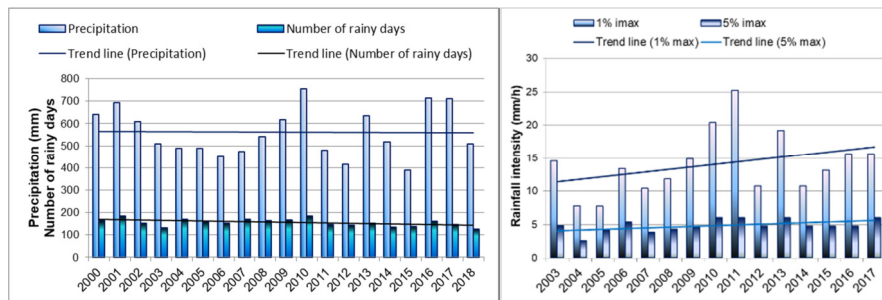


Fig. 2. Precipitation height and number of days with precipitation (a) and the intensity of precipitation with the highest intensity (mm/h) according to 5-minute records (data for 1% and 5% of highest values and trend lines) (b)

Measurements of sewage inflow to GOŚ ŁAM indicate that for about half the days in a year the sewage treatment plant has to cope with increased inflows resulting from precipitation, and several or more times a year the volume of inflowing sewage exceeds twice the reliable maximum flow for the sewage treatment plant, which releases from the need to meet requirements contained in the water-legal permit regarding the composition of discharged wastewater (Table 1). In such cases, some of the wastewater is discharged through a bypass channel without biological treatment. Storage them could help avoid such situations.

Table 1. Number of exceedances of the daily sewage inflow to GOŚ ŁAM Q_d in relation to the maximum dry weather flow for WWTP $Q_m=166.000 \text{ m}^3/\text{day}$

Year	$Q_m < Q_d < 2Q_m$		$Q_d > 2Q_m$	
	monthly	per year	monthly	per year
2017	4-29	201	0-4	14
2018	1-25	143	0-2	5

The analyzes carried out using the US EPA SWMM program have shown that an effective solution limiting sewage discharge to bypass channel is the construction of storage tanks [10,11]. The effectiveness of such tanks depending on their volume is shown in Fig. 3.

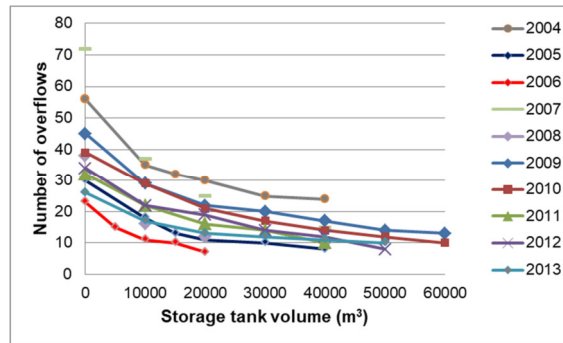


Fig. 3. Impact of separated storage tank volume on the reduction of biologically untreated sewage discharge by the bypass channel at GOŚ ŁAM [11]

It is also possible to use in-sewer storage in the main sewer Polesie XV prior the WWTP with the RTC system. The detention would be forced by 4 pairs of gates installed in the sewer. Exemplary effects of such a solution are presented in Fig. 4.

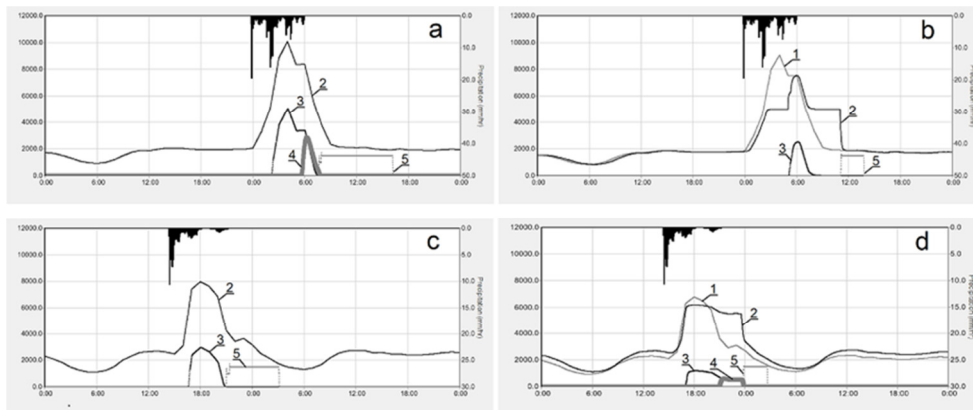


Fig. 4. Example of simulation of WWTP operation with the storage tanks, flow (l/s):
a, b - example of a rainfall with overflow in case of sewage storage in tanks (a) and without overflow in case of additional storage in Polesie XV (b); c, d - example of a rainfall without overflow in case of sewage storage in tanks (c); and with overflow in case of additional storage in Polesie XV (d);
1-inflow to main sewer Polesie XV; 2-inflow to WWTP; 3-inflow to storage tank; 4-overflow from storage tank; 5-storage tank emptying; right axis – precipitation (mm/hr)

Quality of wastewater flowing into WWTP may also change significantly during the wet weather. Stormwater, which in this period may constitute the majority of the entire inflow volume (depending on precipitation parameters) may carry a significant amount of pollutants washed out from the catchment and leached from the sewer deposits, hindering the treatment process. In wet weather, as well as during snowmelt, inflows to WWTP are often characterized by the occurrence of the first flush phenomena. This means that in the beginning of precipitation may in the mixture of municipal wastewater and stormwater much larger amount of pollutants may flows to WWTP than in the further runoff.

The inflow of a large amount of pollutants in very short time, even if there are no toxic substances among them, can cause significant difficulties in the treatment process. Changes in the quality and quantity of sewage flowing into WWTP are not repeatable, they depend primarily on rainfall characteristic and the length of the dry weather period before precipitation, which determines the amount of pollution built-up on the catchment and wash-off during rainfall. Even on the same catchment, in the case of different precipitation, the first flush phenomenon may not be observed, it may be pronounced or the so-called the last wave phenomenon may occur, moreover, the flow of pollutants may be different for basic quality parameters of sewage (Fig. 5).

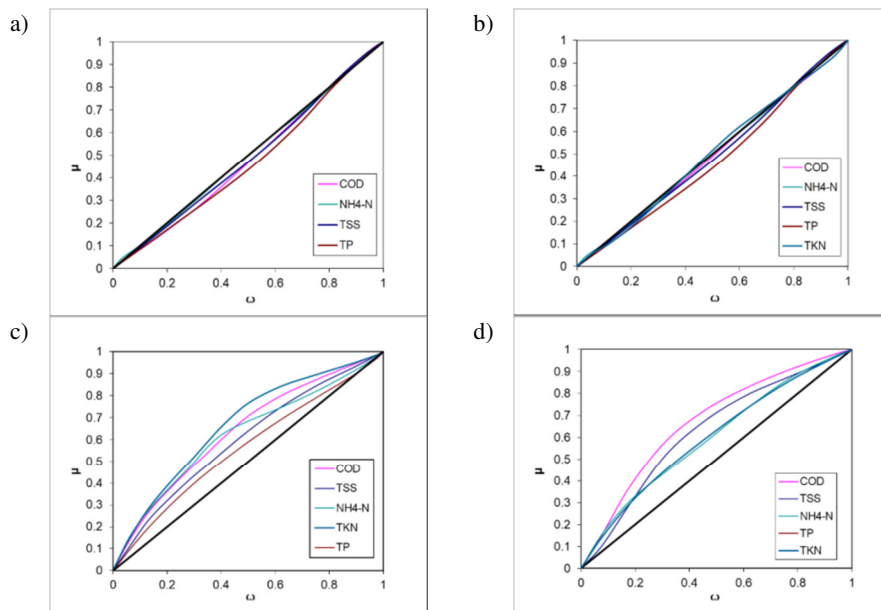


Fig. 5. Analysis of the first flush phenomena in inflow to GOŚ ŁAM: a) storm with a high intensity of precipitation; b) long rainfall of low intensity; c) long-lasting heavy rainfall; d) snowmelt combined with rainfall;

COD – chemical oxygen demand; TSS – total suspended solids; NH₄-N - ammonium nitrogen; TKN - total Kjeldahl nitrogen; TP - total phosphorus; ω - cumulative wastewater volume; μ - cumulative load

An important threat to the WWTP is the inflow of toxic substances that can cause inhibition of biological treatment processes. Such situations took place in September 2011 and April 2019, when as a result of the inflow of unidentified substances to GOŚ ŁAM, inhibition of the nitrification process was found, which resulted in limiting the reduction of nitrogen concentration, a significant increase in the emission of nutrients to the environment, and the threat of non-compliance with legal requirements. The process collapse was associated with the destruction of the nitrifying bacterial population, which is most sensitive to the effects of toxic agents. Restoration of the relevant nitrification process parameters is possible after the termination of toxic substances inflow, and taking action to accelerate the recovery of the bacterial population. This can be done by inoculating the activated sludge with sludge from other treatment plants and dosing preparations containing nitrifying bacteria. Regardless of chosen solutions, the reconstruction can take up to several weeks. This time depends on many factors, including the parameters of treatment process and the nitrogen load in sewage inflowing to WWTP.

As part of the Project “Sewage management, phase III in Łódź” implemented from the Cohesion Fund “The Operational Program Infrastructure and Environment 2014-2020, Priority II Environmental protection, including adaptation to climate change”, two storage tanks for sewage flowing into the treatment plant are being built in GOŚ ŁAM:

- tank I (2-chamber) with a total volume of approx. 15,000 m³;
- tank II (4-chamber) with a total volume of approx. 25,000 m³.

Tanks volume was determined on the basis of many years of observation of inflows to the treatment plant and computer simulations [10]. The total useful capacity of the tanks (40,000 m³) is to ensure the capture of most of the runoff after low and medium rainfall and the most polluted first flush of large runoff, exceeding the volume of the tanks.

Filling of tank I is foreseen after preliminary settling tanks - from the distribution channel to activated sludge chambers (ASC) or after grit chambers (GC), from the distribution channel to preliminary settling tanks (PST), through the designed channel valve. Filling of tank II will take place in a cascade system - after filling tank I or directly with sewage after PSP, from the distribution channel to ASC. The maximum sewage inflow to the preliminary settling tanks was assumed to be about 30,000 m³/h (above this inflow the excess sewage will be directed to tank I). It was assumed that the sewage inflow to ASC will not exceed the value of 18,200 m³/h. Excess wastewater after PST, in the amount of approx. 12,000 m³/h, will be directed through channel valves designed in the distribution channel on the ASC to the storage tank I. The tank chambers will be filled in cascade. After filling the first chambers, excess sewage will overflow to the common channel between tanks I and II, and then to tank II or to the bypass channel. Tank I will be emptied into PST distribution channel, while wastewater from tank II will be directed to distribution channel to ASC through a system of designed pump systems.

3. Concept of the system

Optimal use of storage tanks requires information on quality and quantity of wastewater flowing into the GOŚ ŁAM and the forecast of their changes. If the excess volume of wastewater after rainfall is taken over by the tanks, it will be possible to fully clean it after the increased inflow stops. Also, if significant changes in sewage quality are identified that may affect their biological treatment, it will be possible to divert this type of inflow to tanks. Therefore, having information on the current composition of sewage in the sewer system and forecasting inflow to the treatment plant will facilitate optimal use of the technological possibilities of WWTP. The above premises, analysis of the current state of knowledge and technical capabilities, as well as experience in the field of monitoring and modelling of the Lodz sewage system constitute the basis for the development by Lodz University of Technology, Institute of Environmental Engineering and Building Installations, and Wastewater Treatment Plant of Lodz, Ltd. the prototype of monitoring, early warning and sustainable management system for GOS ŁAM. The system will be based on measurement data from three main sources, these are:

- existing pluviometer system in the city, consisting of 18 raingauges, of which 5 are located on the combined catchment,
- flow measurement system in sewers next to 18 combined sewer overflows,
- newly constructed 4 stations (Fig. 6) for qualitative monitoring of wastewater in the sewage system with on-line sensors measuring min. 8 parameters on each station (pH, conductivity, organic substances, ammonium nitrogen, suspended solids/turbidity, chlorides, BTX, hydrogen sulphide). Research on sewage quality with on-line probes conducted on the J1 CSO since 2011, as well as previous tests on the inflow to GOŚ ŁAM [12] showed that these types of stations can be successfully used for assessment of sewage quality and amount of pollutant emissions from the sewage system.

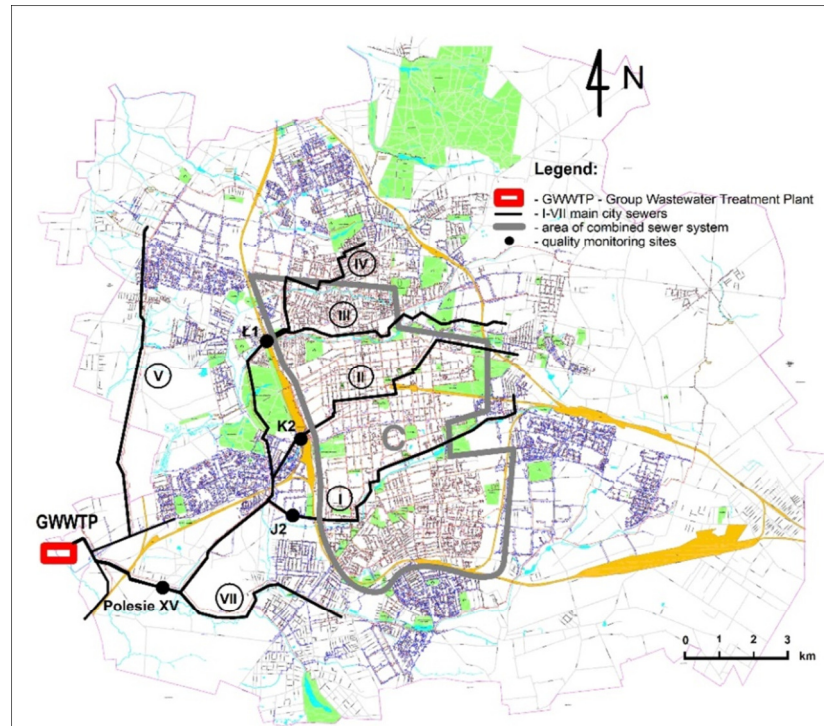


Fig. 6. Location of sewage quality monitoring stations in the Lodz sewage system

The benefits of introducing the system include:

- receiving, well in advance, reliable information by sewage treatment plant employees on anticipated significant quantitative and qualitative changes in inflowing sewage and the possibility of a threat to biological treatment processes. This creates the opportunity to optimally control the treatment plant, both the parameters of the treatment process and flows;
- ability to direct part of the wastewater into storage tanks (especially after receiving information about the potential toxicity), or - in exceptional cases - to a bypass channel. In a situation where there is a suspicion of the inflow of hazardous substances, the tanks will allow for their storage, collection of sewage samples and their analysis as well as determination of the way to proceed (referring to biological treatment or neutralization);
- improving the quality of wastewater discharged to the receiving water in wet weather. The inflow of significant amounts of stormwater sometimes causing the necessity of discharging part of it through a bypass channel before biological treatment, as a result worsens the quality of sewage discharged by the treatment plant. According to the conducted analyses [13], limiting the operation of the bypass channel and the volume of discharges by 70% will allow reducing the emissions of basic pollutants by approx. 2.7–6.8%

depending on the parameter (BOD₅, COD, total suspended solids, total nitrogen and total phosphorus);

- avoiding unforeseen costs associated with the emission of sewage not meeting the quality requirements and the elimination of breakdowns.

The developed system will also enable visualization, archiving and reporting of data that can be used for further analyzes related to the modernization or expansion of the facility and its adaptation to climate change, urbanization and the growing requirements of receiving water protection.

The system, based on only 4 stations for monitoring the quality of sewage, will not yet allow full control of the inflow to the GOŚ ŁAM due to the existing sewer system layout in the city. Current research on sewage quality (including toxicity) in the entire sewer system should allow to determine the quality characteristics of sewage discharged from the whole catchment, which will allow more accurate inflow forecasting, but this will not take into account uncontrolled pollutant discharges into not monitored sewers. For this reason, the system will probably need to be expanded in the future. The developed system should be characterized by reliability in case of failure of one or more measuring elements - raingauges, flow meters or sensors used to sewage quality monitoring. The use of quantitative and qualitative on-line monitoring of the sewage system is a very convenient and promising tool that facilitates solving many operational and modernization problems, however it creates many operational difficulties. There may be gaps in measurements or the measurement data is of poor quality. However, it can be assumed that the rapid progress in the development of on-line measurement methods and the expansion of experience in the field of operation of this type of equipment will contribute to the improvement of the efficiency and reliability of such solutions.

4. Summary

The monitoring, early warning and sustainable management system currently being developed in Lodz will be an important technological innovation in the sewage disposal and treatment system enabling progress towards its fully balanced operation and will allow better protection of the receiving water. The construction of the system will enable the integration of the existing monitoring systems in the city with new elements, resulting in the creation of a modern, intelligent tool for environmental protection and optimization of expenses for this purpose.

“Project co-financed by the European Union financed from the European Regional Development Fund under the Smart Growth Operational Programme. The project is implemented as a part of the National Centre for Research and Development: Regional Science and Research Agendas competition.”

References

- [1] Black G., Jones M., Vale P., Johnson N., Nocker A., Cartmell E., Dotro, G., Biofilm Responses to Toxic Shocks in Closed Pipes: Using Nitrous Oxide Emissions as an Early Warning of Toxicity Ahead of a Wastewater Treatment Works, *Water, Air and Soil Pollution*, 2014, 225, 2, 1837.
- [2] Vasquez M.I., Fatta-Kassinos D., Is the evaluation of “traditional” physicochemical parameters sufficient to explain the potential toxicity of the treated wastewater at sewage treatment plants? *Environ Sci Pollut Res*, 2013, 20:3516–3528.
- [3] Liwarska-Bizukojć E., Ślęzak R., Klink M., Study on wastewater toxicity using ToxTrak™ method, *Environmental Science and Pollution Research*, 2016, 23:9105–9113.
- [4] García L., Barreiro-Gomez J., Escobar E., Téllez D., Quijanoa N., Ocampo-Martinez C., Modeling and real-time control of urban drainage systems: A review, *Advances in Water Resources*, 2015, 85, 120–132.
- [5] Schilling W., Andersson B., Nyberg U., Aspegren H., Rauch W., Harremoës P., Real time control of wastewater systems, *Journal of Hydraulic Research*, 2010, 785-797.
- [6] Seggelke K., Löwe R., Beeneken T., Fuchs L., Implementation of an integrated real-time control system of sewer system and waste water treatment plant in the city of Wilhelmshaven, *Urban Water Journal*, 2013, 10, 5, 330-341.
- [7] van Daal P., Gruber G., Langeveld J., Muschalla D., Clemens F., Performance evaluation of real time control in urban wastewater systems in practice: Review and perspective, *Environmental Modelling & Software*, 2017, 95, 90-101.
- [8] Vezzaro L., Christensen M.L., Thirsingd C., Grumb M., Mikkelsen P.S., Water quality-based real time control of integrated urban drainage systems: a preliminary study from Copenhagen, Denmark, *Procedia Engineering*, 2014, 70, 1707–1716.
- [9] Langeveld J., Van Daal P., Schilperoort R., Nopens I., Flameling T., Weijers S., Empirical sewer water quality model for generating influent data for WWTP Modelling, *Water*, 2017, 9, 491.
- [10] Zawilski M., Sakson G., Analiza możliwości retencjonowania ścieków ogólnospławnych dla potrzeb Grupowej Oczyszczalni Ścieków w Łodzi, *Katedra Inżynierii Środowiska PŁ na zlecenie GOŚ ŁAM*, 2008.
- [11] Sakson G., Zawilski M., Brzezinska A., Analysis of combined sewer flow storage scenarios prior to wastewater treatment plant, *Ecological Chemistry and Engineering S*, 2018, 25(4), 619–630.
- [12] Brzezinska A., Zawilski M., Sakson G., Assessment of pollutant load emission from combined sewer overflows based on the online monitoring, *Environmental Monitoring and Assessment*, 2016, 188, 9.
- [13] Zawilski M., Sakson G., Brzezińska A., Zrównoważone gospodarowanie wodami opadowymi na obszarach zurbanizowanych w aspekcie ochrony wód odbiornika, „Infrastruktura miast” pod red. J. Dziopaka, D. Słysia i A. Stec, Oficyna Wydawnicza Politechniki Rzeszowskiej, ISBN 978-83-7934-166-5, 2017.

Przesłano do redakcji: 22.08.2019 r.